

June 25, 2020

Justin P. Jobin
Environmental Projects Coordinator
Suffolk County Dept. of Health Services
Wastewater Management, Suite 2C
360 Yaphank Ave.
Yaphank, NY 11980

Dear Mr. Jobin:

Subject: Multiple Lateral Discharge to Fuji Clean CEN-Series Units

The question has arisen as to whether multiple laterals may discharge to a Fuji Clean CEN-Series unit. The question arises because there are parcels that may have two or more buildings discharge to a single unit. Fuji Clean allows multiple laterals to discharge to a single unit when the laterals merge into a single discharge and cleanouts are provided for each lateral.

Figure 1 illustrates a typical situation in which two laterals discharge into a single unit. In this example, a connection is made using a wye, and cleanouts are provided on each lateral so blockages, however unlikely, could be cleared. Please note that this wye and associated upstream cleanout configuration may be located at any point along the incoming waste line preceding the Fuji Clean treatment unit.

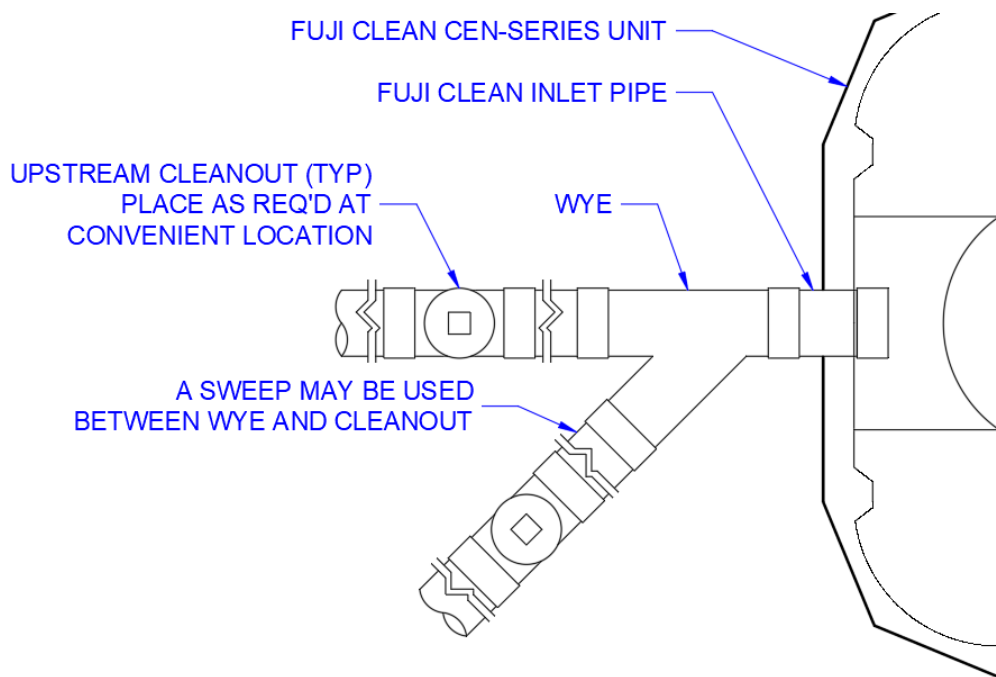


Figure 1—Inlet Laterals to Fuji Clean Unit

Justin P. Jobin
Multiple Lateral Discharge to Fuji Clean CEN-Series Units
February 15, 2018
Page 2 of 2 Pages

Note that other configurations are possible. For example, a sweep may precede the wye on either lateral. The important factor is that the pipe slope is maintained and cleanouts are provided as required by local code and/or best practices.

Please feel free to contact me if you have additional questions, concerns, or issues. I will be glad to address them.

Sincerely,

A handwritten signature in blue ink, appearing to read "Scott Samuelson", with a long horizontal flourish extending to the right.

Scott Samuelson
Managing Director